DESIGN AND CONSTRUCTION OF FORWARD REVERSE STAR-DELTA CONTROL

This Report Presented in partial fulfillment of the requirements for the Award of Degree of
Bachelor of Science in Electrical and Electronic Engineering



SUBMITTED BY

Sheikh Khurshid Alam
ID: EEE 1803015104

Md. Shafiul Alam
ID: EEE 1901016162

Md. Masiur Rahman
ID: EEE 1901016193

Md. Firoj Mia
ID: EEE 1901016132

Md. Shah Alam
ID: EEE 1901016186

SUPERVISED BY

Md. Rakibul Alam
Assistant Professor
Department of EEE
Sonargaon University

@ Sonargaon University

LETTER OF APPROVAL

This is to certify that this project and thesis entitled "**DESIGN AND CONSTRUCTION OF AUTOMATIC STAR-DELTA STARTER CONTROL"** is done by the following students under my direct supervision and this work has been carried out by them in the laboratories of the Department of Electrical and Electronic Engineering under the Faculty of Engineering of Daffodil International University in partial fulfillment of the requirements for the degree of Bachelor of Science in Electrical and Electronic Engineering. The presentation of the work was held on September-2022

Signature of the candidates.

Sheikh Khurshid Alam Md. Shafiul Alam Md. Masiur Rahman

Md. Firoj Mia Md. Shah Alam

Countersigned

Md. Rakibul Alam
Assistant Professor
Department of EEE
Sonargaon University

@ Sonargaon University

Dedicated to

Our Parents

@ Sonargaon University

CONTENTS

Letter of Approval		**ii**
Dedication		**iii**
List of Tables		**viii**
List of Figures		vii
List of Abbreviations		**ix**
Acknowledgment		**x**
Abstract		**xi**
Chapter 1:	**INTRODUCTION**	**1-3**
1.1	Introduction	1
1.2	Problem Statement	2
1.3	Objectives	2
1.4	Methodology	2
1.5	Thesis Outline	3
Chapter 2:	**LITERATURE REVIEWS**	**4-10**
2.1	Introduction	4
2.2	Star-Delta connection	4
2.2.1	Star or Y-connected system	6
2.2.2	Delta or Mesh Connected Circuit	6
2.3	Theory of Star Delta Starter Method of Starting of Induction Motor	7
2.4	Working Principle of Induction Motor & Star-Delta Starter	9
2.5	Necessity of star delta starter	10

@ Sonargaon University

Chapter- 3	**DESIGN METHODOLOGY**	**16-17**
3.1	Introduction	16
3.2	Block diagram of star-delta starter	16
3.3	Flowchart	17
Chapter 4:	**HARDWARE DESCRIPTION**	**18-24**
4.1	Introduction	18
4.2	Hardware parts	18
4.2.1	Magnetic conductor	18
4.2.2	Overload Relay	19
4.2.3	Timer Relay	20
4.2.4	START and STOP push buttons switch	20
4.2.5	Cable	21
4.2.6	Interlock switches	21
4.3	Circuit diagram	22
4.4	Operating principle	22
Chapter-5	**RESULT AND COST ANALYSIS**	25-26
5.1	Introduction	25
5.2	Results	25
5.3	Three phase motor rating for star delta starter	25
5.4	Cost sheet	26
5.5	Cost comparison	26

@ Sonargaon University

Chapter 6:	**ADVANTAGE & DISADVANTAGE**	**27-28**
6.1	ADVANTAGE	27
6.2	DISADVANTAGE	28
Chapter 6:	**CONCLUSIONS**	**28-31**
7.1	Conclusion	28
7.2	Limitations of the Work	28
7.3	Future Scopes	29
	References	30
	Appendix	31

LIST OF FIGURES

Figure #	Figure Caption	Page #
1.1	Motor starting period Vs. Steady state running period	2
2.1	Star connected system	5
2.2	Delta connected of system	6
2.3	Starting current of motor	9
2.4	Torque vs. speed curve for Delta connection	10
2.5	Current vs. speed curve for Delta connection	11
2.6	Torque vs. speed curve for Star connection	12
2.7	Current vs. speed curve for Star connection	12
2.8	Torque vs. speed curve: Star and Delta connections compared	13
2.9	Current vs. speed curve: Star and Delta connections compared	14
3.1	Block diagram of star-delta starter	16
3.2	Flowchart	17
4.1	Magnetic conductor	19
4.2	Overload relay	20
4.3	Timer & Circuit diagram	21
4.4	Start and stop button push switch	21
4.5	Power circuit diagram of automatic star delta starter	22
4.6	Circuit diagram of open and closed transition starter	24

@ Sonargaon University

LIST OF TABLES

Table #	Table Caption	Page #
2.1	120kW motor's performance values running in delta	10
2.2	120kW motor connected in star	11
2.3	120kw motor performance values: Delta and star connection	13
2.4	Relation between phase and line Currents and Voltage	14
5.1	Three phase motor current rating for star delta	26
5.2	Cost sheet	26

@ Sonargaon University

List of Abbreviations

MC	Magnetic Conductor
TR	Thermal Relay
HP	Horse power
FLC	Full load current
DOL	Direct Online Starting
V	Voltage
I	Current

@ Sonargaon University

ACKNOWLEDGEMENT

First of all, we give thanks to Allah. Then we would like to take this opportunity to express our appreciation and gratitude to our project and thesis supervisor **Md. Rakibul Alam, Assistant Professor, Department of EEE, Sonargaon University** for being dedicated in supporting, motivating and guiding us through this project. This project can't be done without his useful advice and helps. Also thank you very much for giving us opportunity to choose this project.

To our beloved family, we want to give them our deepest love and gratitude for being very supportive and also for their inspiration and encouragement during our studies in this University.

@ Sonargaon University

ABSTRACT

The star delta starter of induction motor is designed to reduce high starting current and torque. The star delta starter is designed by three magnetic contactors, an overload relay, timer relay and circuit breaker. For Starter, a motor must be connected in delta mode position during a normal run. When induction motor is start in direct online .The motor winding flow a large amount of current .The starting high current can be reached in 8-10 times of the rated. So there is need to control high starting current before starting the motor Therefore, in a star connected system line current is equal to phase current but line voltage is equal to the root three times of phase voltage. For this reasons at first motor is connected to the star system and it reduce the high starting current. In delta connection, line voltage is equal to phase voltage and line current is equal to √3 times phase current. In run mode the motor connect in delta system so that the full voltageapplied to the motor. The Starter is made by three magnetic contactors, timer relay, and a thermaloverload relay or circuit breaker.

@ Sonargaon University

@ Sonargaon University

CHAPTER -1

INTRODUCTION

1.1 Introduction of Star-Delta Control:

Induction motor is the most common types of electric motor in industry. This is motor very simple structure any other moving machine. But the motor is very power full and high efficiency. The most common feature of the motors are low cost, quick pick up and easy maintenance. If the induction motor start in DOL method, the motor is started with application of full voltage and the starting current will be 7-10 times of rated current. So large induction motors do not start DOL method. Another induction motor start only star system, its gives low torque and if motor start only delta method, its gives high starting current. So we need a secure protection to avoid such conditions and protect the motor. For this reason we use forward reverse star delta control system with help of magnetic conductor, timer relay and overload protection. This is the best protection against high current.

1.2 Problem statement:

Three phase induction motor is a self-starting electric machine. The rotating field has to be produced electromagnetic field and rotor flow the current. If the load increase on the motor, a large amount of current flows through the rotor. For this reasons stator can draw heavy current and coil get heated up. Due to the excessive heat coil winding insulation fail and damage the motor. At the starting time the slip=1, therefore the rotor resistance become zero (Rs =R2/ (1-s). To limit this starting current we need a starter of induction motor. The voltage is reduce to one way, which in turn reduces the torque.

@ Sonargaon University

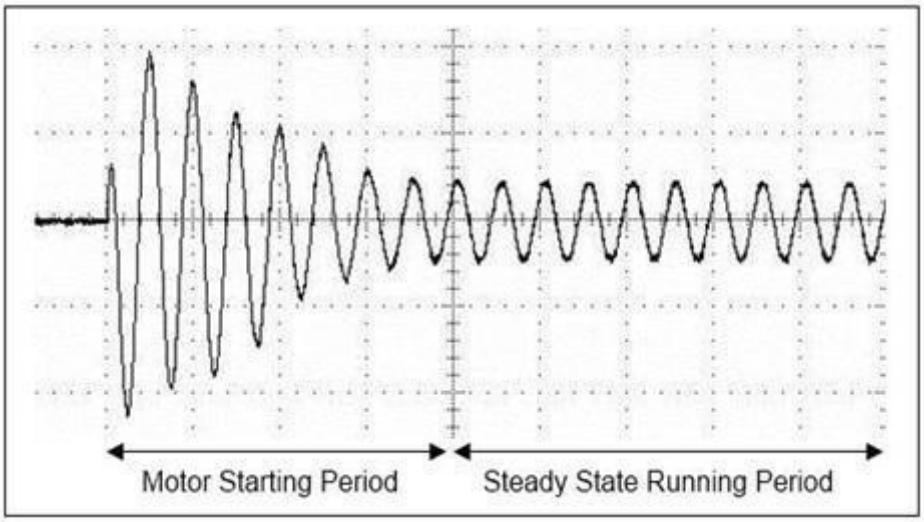


Figure-1.1: Motor starting period Vs. Steady state running period

1.3 Objective:

1. Designed a forward reverse star-delta control
2. Implemented the design.
3. Performance and cost analysis.
4. Reduce high starting current
5. Provide over-burden and no-voltage assurance

1.3 Methodology:

1. Studied about the star-delta control
2. Studied about the theory of induction motor
3. Constructed and Performance test of a forward reverse star-delta control

1.5 Thesis outline:

Generally this project report is divided into six chapters, where it consists of;

Chapter- 1: Introduction

Chapter- 2: Literature Review

Chapter- 3: Theoretical Model

Chapter -4: Hardware Description

Chapter -5: Result and Discussions

Chapter -6: Conclusions and recommendation

Chapter-1 is the introduction of the main idea and important of this project. In this chapter, we first explain the problem of starting of induction motor then describe the existing solution of its. After that we describe out proposed solution for starting of induction motor. Then describe the objective and working methodology.

Chapter- 2 is the Literature Review of the project. In this chapter discuses of some related system and working principle of induction motor & star delta starter.

Chapter- 3 is the Theoretical model of the project where describe the operating principle of the project.

Chapter -4 is the Hardware description of components where describe the all components that are used in the project.

Chapter -5 is the Result and Discussion where all the tested result is obtained. In this chapter also discuss the cost analysis of the project.

Chapter -6 is the Conclusions and recommendation. In this chapter we discuss about the conclusion, limitation of the project and future work of the project

CHAPTER 2

LITERATURE REVIEWS


2.1 Introduction:


In this chapter, literature review that is to this study that is related to this study case will be identified and study. Normally, paper are interrelated by means of the subject matter induction motor starting high current reduce by means of using star-delta starter. When the motor is started, stator draws high current which is 8-10 times that of the rated current. These papers research about star delta starter that is purpose to get scientific information, analysis and study the weakness, concept and method to improve starting period of induction motor through the development of the project.

2.2 STAR-DELTA CONNECTION:

2.2.1 Star or Y-connected system:

When three coils or windings, placed 120^0 apart, are connected together at a common point as shown in below figure, they form star or Y-connected circuit. The common point is called the Neutral or Star point.

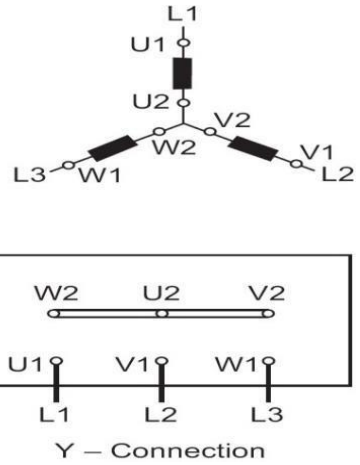

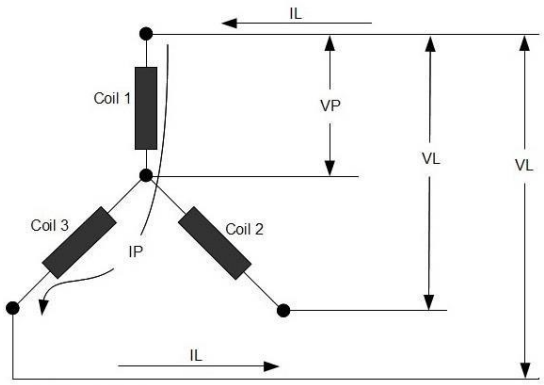

@ Sonargaon University

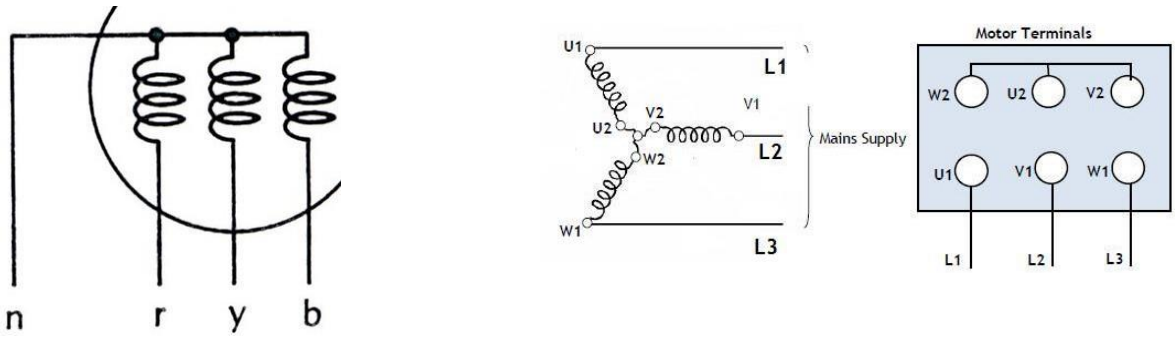


Figure 2.1: Star connected system

When only three main lines are drawn, it is said to be a 3-phase, 3-wire system. Often a neutral line is also drawn from the neutral point. In this case the system is called a 3-phase, 4 wire system.

The current flowing through each coil is called phase current and that flowing through main line is called line current. It can be seen in figure that each phase or coil is connected series with its respective main line.

Therefore, in a star connected system line current is equal to phase current i.e. the same current flows through a phase and main line connected series with it.

In a 3-phase, 4- wire system two different values of voltage are available. Each coil is connected across a main line and the neutral line as shown in figure. Therefore, voltage across a coil or phase is equal to voltage between a main line and the neutral. This voltage is called phase voltage. The voltage between any two main lines is called line voltage.

Line voltage, $V_L = \sqrt{3}V_P$

The power in a 3-phase, star connected system:

Power per phase = $V_P I_P \cos\Theta$

Hence the total power for all the three phase is given by,

$$P = 3V_P I_P \cos\Theta$$

$$= \sqrt{3}V_L I_L \cos\Theta$$

Total apparent power of the three phase = $3V_P I_P$

$$= \sqrt{3}V_L I_L \text{ (VA)}$$

Total reactive power of the three phase $= 3V_P I_P \sin\Theta$

$$= \sqrt{3}V_L I_L \sin\Theta \text{ (VA) or (VAR)}$$

@ Sonargaon University

2.2.2 Delta or Mesh Connected Circuit:

In delta connection no neutral point is available. With this connection only three-phase, three wire system is possible.

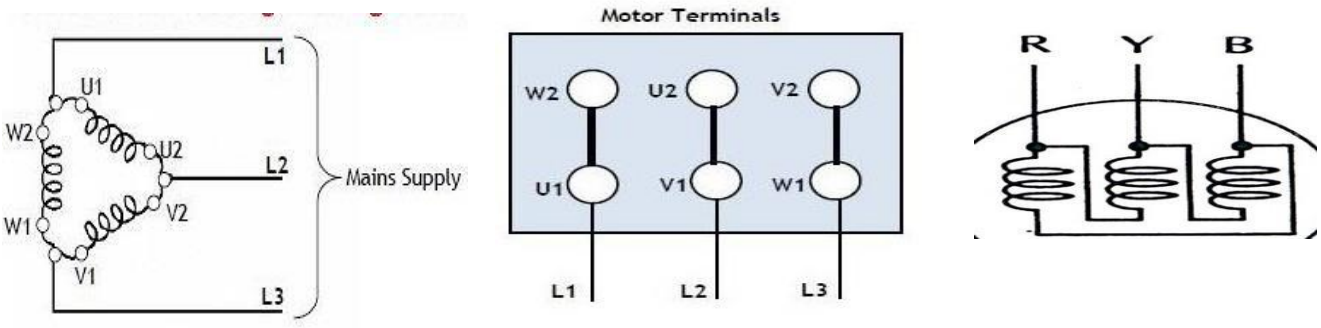


Figure 2.2: Delta connected of system

In delta or Mesh connection each coil or phase is connected across two main lines. Therefore in delta connection, line voltage is equal to phase voltage. Two different values of supply voltage cannot be obtained with this connection. In a delta connected system line current is equal to √3 times phase current.

Line current, $I_L = \sqrt{3} I_P$

The power in a 3-phase, star connected system:

Power per phase = $V_P I_P \cos\Theta$

Hence the total power for all the three phase is given by,

$$P = 3V_P I_P \cos\Theta$$

$$= \sqrt{3} V_L I_L \cos\Theta$$

Total apparent power of the three phase = $3V_P I_P$

$$= \sqrt{3} V_L I_L \text{ (VA)}$$

Total reactive power of the three phase = $3V_P I_P \sin\Theta$

$$= \sqrt{3} V_L I_L \sin\Theta \text{ (VA) or (VAR)}$$

@ Sonargaon University

2.3 Theory of Forward Reverse Star Delta controlling system of Motor:

Let,

- Istyp = starting phase current in star.
- Istyl= starting line current in star

For the star connection, line current = phase current

Therefore, Istyp=Istyl

If,

- V_1 = phase voltage
- V_L = line voltage
- IstΔl =per line current in delta.
- IstΔp =per phase current in delta.
- Ze10 = equivalent per phase impedance

$$\text{Istyp} = \frac{\text{V1}}{\text{Ze10}} = \frac{\text{VL}}{\sqrt{3}\text{Ze10}}$$

$$\text{IstΔp} = \frac{\text{VL}}{\text{Ze10}}$$

For Delta connection, Line current, $I_L = \sqrt{3} I_P$.

Therefore,

$$\text{IstΔl} = \sqrt{3}\,\text{IstΔp} = \frac{\sqrt{3}\text{VL}}{\text{Ze10}}$$

Therefore,

$$\frac{\text{starting line current with star delta starting}}{\text{starting line current with direct switching in delta}} = \frac{\text{IstΔp}}{\text{IstΔl}}$$

$$\frac{\text{VL}/\sqrt{3}\text{Ze10}}{\sqrt{3}(\text{VL}/\sqrt{3}\text{Ze10})} = \frac{1}{3} \quad \ldots\ldots (1)$$

@ Sonargaon University

Star delta starter, the starting current from the main supply is 1/3 in the delta switching.

Also,

$$\frac{\text{starting torque with star delta starting}}{\text{starting torque with direct switching in delta}} = \frac{(VL/\sqrt{3})^2}{VL^2} = \frac{1}{3} \ldots\ldots 2$$

Star delta starting, the starting torque is reduced to 1/3 of the starting torque in the delta switching.

$$\frac{\text{starting torque with star delta starting}}{\text{starting torque with direct switching in delta}} = \left(\frac{I_{styp}{}^2 \times \frac{R2}{1}}{2\pi ns}\right) + \left(\frac{(I_{fl\Delta p})^2}{2\pi ns} \times \frac{R_2}{s_{fl}}\right.$$

$$= \left(\frac{I_{styp}}{I_{fl\Delta p}}\right)^2 xs_{fl}$$

Where,

$I_{fl\Delta p}$ is the full load phase current with the winding in the Delta

But,

$$Istyp = \frac{VL/\sqrt{3}}{Ze10}$$

$$Ist\Delta p = \frac{VL}{Ze10}$$

Therefore

$Istyp = \frac{1}{\sqrt{3}} Ist\Delta p$ $\quad$ And$Istyp^2 = \frac{1}{3} Ist\Delta p^2$

$$\frac{\text{starting torque with star delta starting}}{\text{starting torque with direct switching in delta}} = \left(\frac{I_{styp}}{I_{fl\Delta p}}\right)^2 xs_{fl}$$

$$= \frac{1}{\sqrt{3}} \left(\frac{I_{styp}}{I_{Fl\Delta p}}\right)^2 xs_{fl} \ldots 3$$

Hence, the equation 3 shown above gives the starting torque of an induction motor in the star delta starting method.

@ Sonargaon University

2.4 Working Principle of Forward reverse Star-Delta control:

The induction motor has two main parts. The input power is given to stator. Three phase induction motor when connected to the power supply the stator produce RMF. The RMF is the one which makes the rotor turn. As per law, rotor start rotating in direction and reverse flow the electric current. So the rotor is like current carrying bars immersed in a magnetic field. This will induce an electromagnetic force according to Lorentz force law and the rotor will rotate in the same direction as the RMF. This is how the induction motor works.

Electricity is induced on the rotor bars due to electromagnetic induction rather than direct connection. Initially the induction motor rotor speed is zero and gradually increase the speed. This means the rotating magnetic field will cut the rotor bar at very high rate.

As the rotor gain speed the rate of flux cut will decrease. So a high current will be induced on the bars at the start. As the rotor speed increases the current will lower the normal value. At the start stator current also must be high since the rotor and stator current are coupled due to transformer action. Due to this the stator coils will draw a huge amount of current when the motor starts.

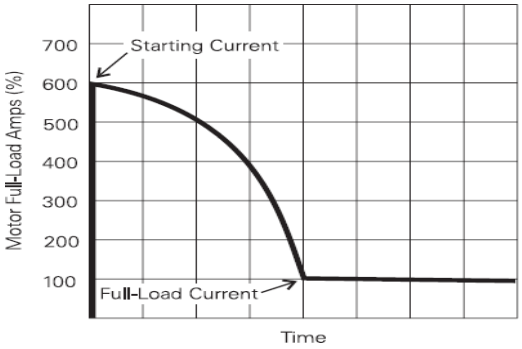


Figure 2.3: Starting current of motor

The main purpose of star-delta starter is to reduce the requirement of high starting current. Normally the starting current of an induction motor is 6 to 7 times of the full load current. This will produce a large voltage drop in the line and affect other devices when a heavy rating induction motor starts. As well as for larger motor the starting current may be so high that it may damage the stator coil or even the power cables. When we apply a three phase voltage across a star connection each coil will receive a much reduced voltage ($V_P=V_L/\sqrt{3}$).


Reduced input voltage means reduced current at the starter coil. So to overcome the high starting current need to connect of star delta starter.

2.5 Necessity of star delta control:

Let's consider an example: 120kW, 4 Pole, 380 Volt, Delta connected, 3 Phase, 50 Hz. First we will examine the normal running condition, i.e. when the motor is connected in Delta. The motor's performance values are listed in table 2.1. It is crucial that we also examine the torque vs. speed and current vs. speed curves. These curves are shown in graphs.

Item	Load		
	Full Load	Starting	Unit
Power	120	101	kW
Voltage	380	380	V
Current	210	1530	A
	1.00	7.30	Pu
Efficiency	93.9	0.0	%
Power Factor	0.87	0.10	
Speed	1491	0	rpm
Torque	769	1038	Nm
	1.00	1.35	pu

Table-2.1: 120kW motor's performance values running in delta

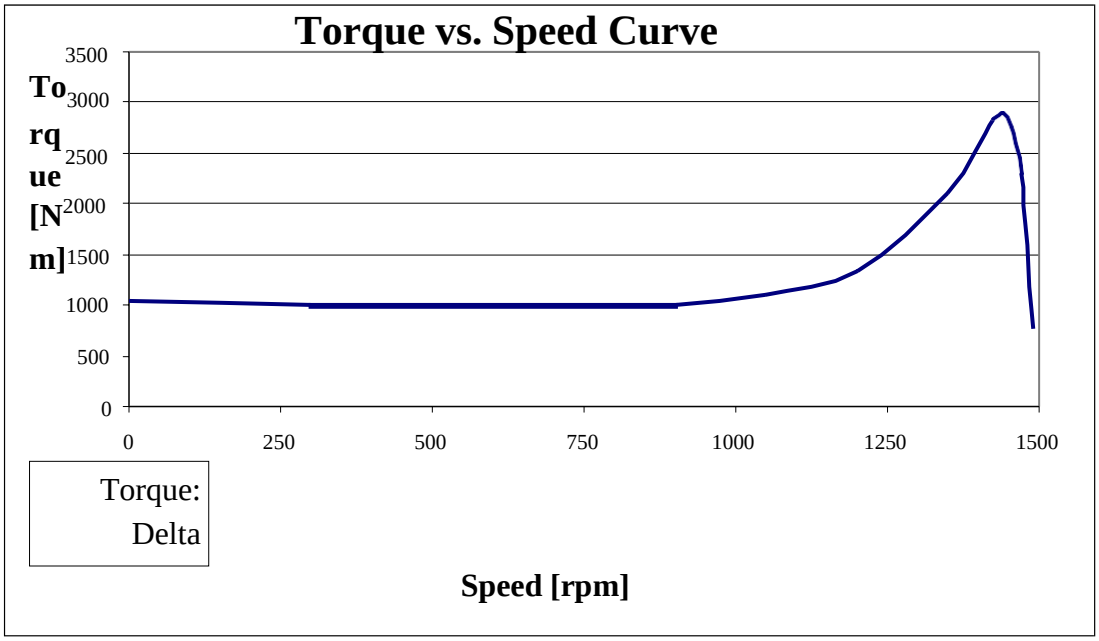

@ Sonargaon University

Figure-2.4: Torque vs. speed curve for Delta connection

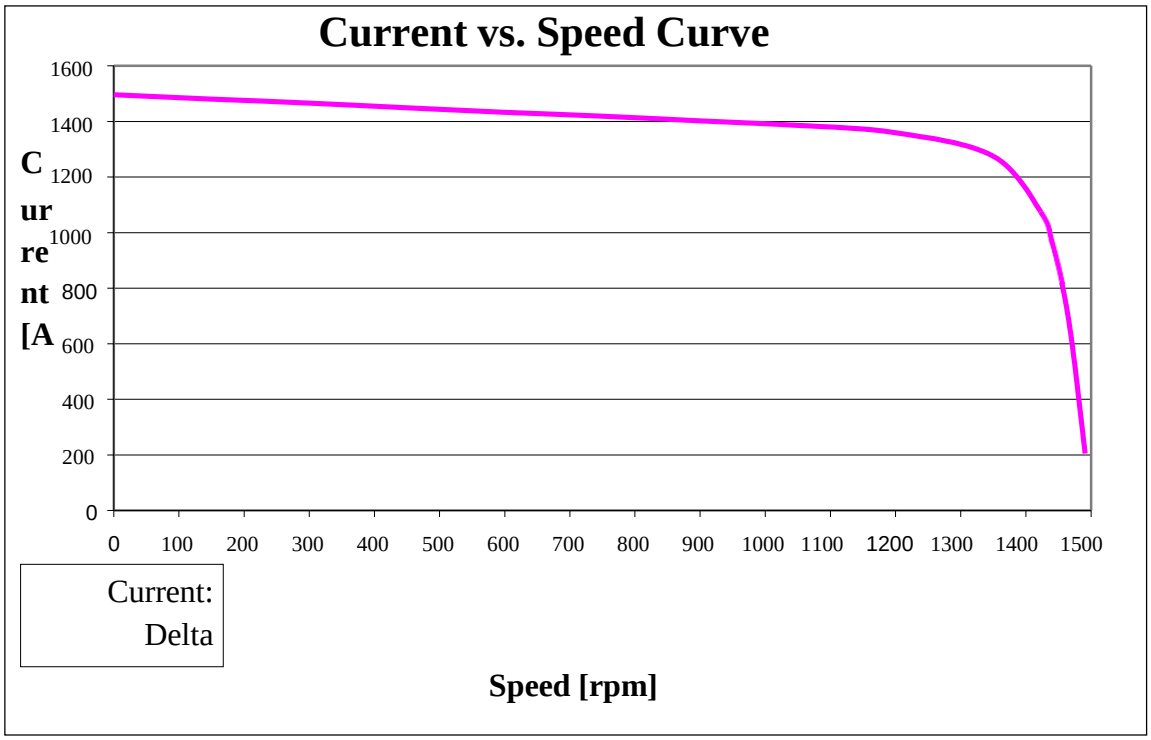


Figure-2.5:Current vs. speed curve for Delta connection

Now let's have a look what happens when the motor is connected in STAR, i.e. in the starting condition. The performance values are listed in Table 2. Graphs 3 and 4 again show the torque vs. speed and current vs. speed curves.

Item	**Load**		
	Full Load	**Starting**	**Unit**
Power	120	33	kW
Voltage	380	380	V
Current	212	500	A
	1.00	2.36	pu
Efficiency	92.3	0.0	%
Power Factor	0.86	0.10	
Speed	1469	0	rpm
Torque	780	343	Nm
	1.00	0.44	pu

Table 2.2: 120kW motor connected in star

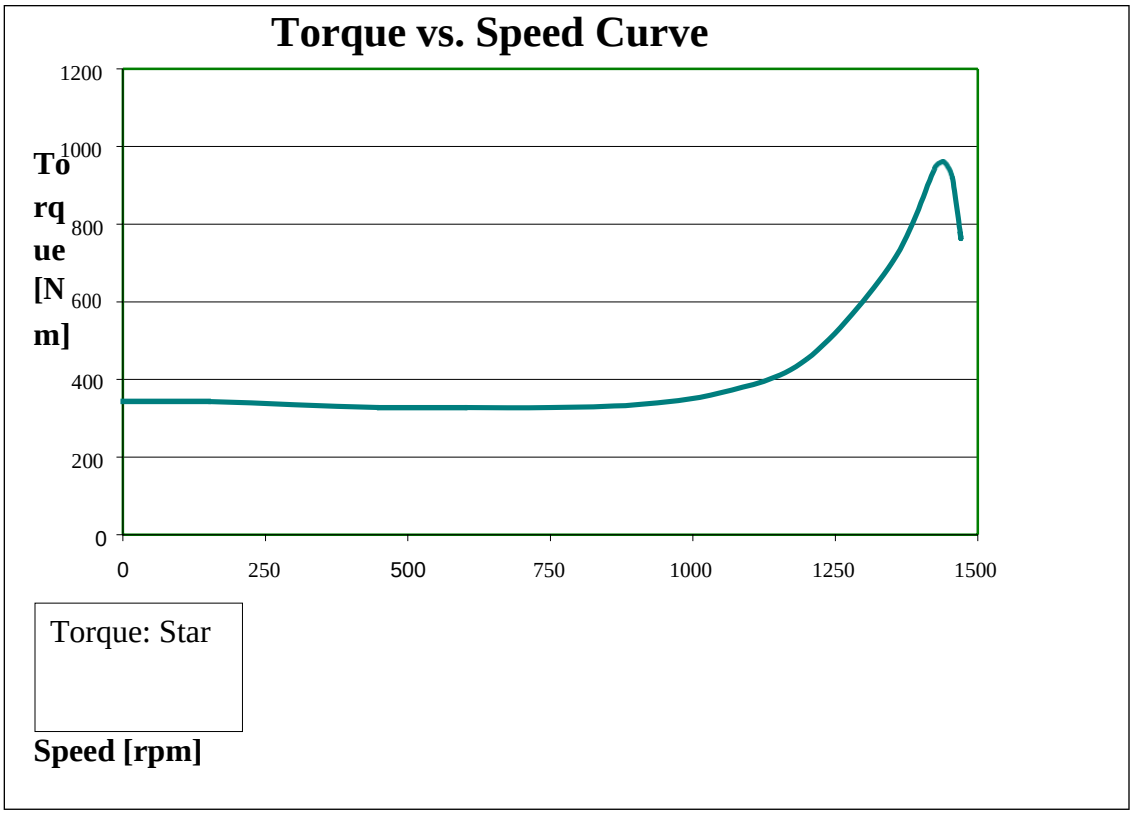


Figure-2.6: Torque vs. speed curve for Star connection

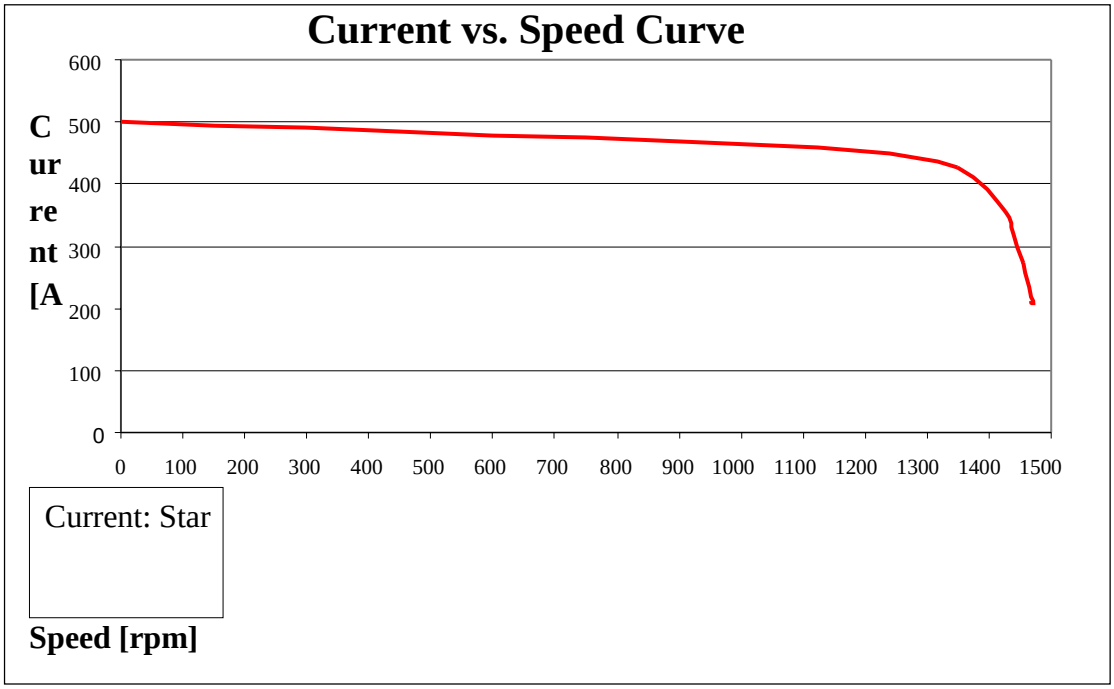


Figure2-2.7: Current vs. speed curve for Star connection

To truly grasp the differences between these two starting methods, we will list the values next to each other in table 2.3, and on graphs 2.5 and 2. 6.

	DELTA CONNECTED		STAR CONNECTED		
Item	**Load**		**Load**		
	Full Load	**Starting**	**Full Load**	**Starting**	**Unit**
Power	120	98	120	33	kW
Voltage	380	380	380	380	V
Current	205	1495	212	500	A
	1.00	7.30	1.00	2.36	pu
Efficiency	93.9	0.0	92.3	0.0	%
Power Factor	0.89	0.10	0.86	0.10	
Speed	1491	0	1469	0	rpm
Torque	769	1038	780	343	Nm
	1.00	1.35	1.00	0.44	pu

Table-2.3: 120kW motor performance values: Delta and Star connection comparison

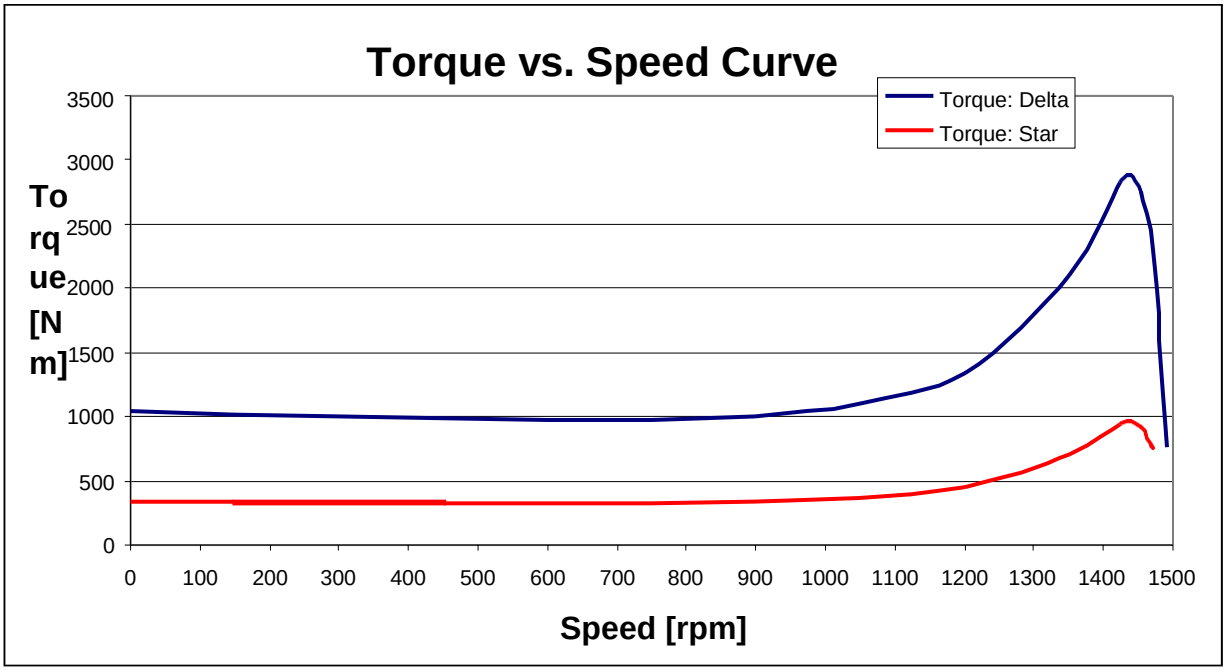


Figure-2.8-: Torque vs. speed curve: Star and Delta connections compared

@ Sonargaon University

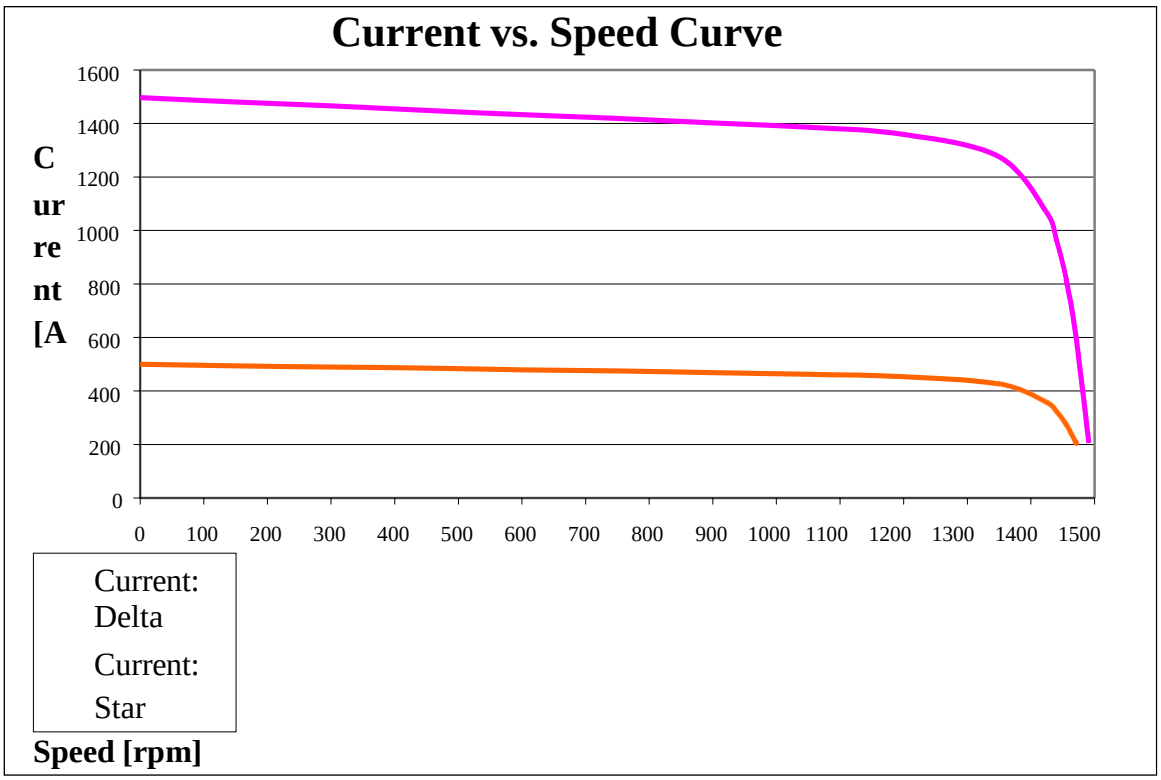


Figure-2.9: Current vs. speed curve: Star and Delta connections compared

The relations for star and delta connections are as listed in Table 2.3:

	Star	Delta
Voltage	$V_{Line} = \sqrt{3} \times V_{Phase}$	$V_{Line} = V_{Phase}$
Current	$I_{Line} = I_{Phase}$	$I_{Line} = \sqrt{3} \times I_{Phase}$

Table 2.4: Relation between phase and line Currents and Voltage

Thus, when the motor is started in the star connection, the phase voltage of the motor is reduced by a factor of √□3.

@ Sonargaon University

The reductions in starting current, starting power, and starting torques for a reduced Voltage can each be calculated by using equation 1 (This ignores other factors like saturation, etc.):

$$\text{Reduction in Value}[\%] = \left[1 - \left(\frac{\text{Nominal Voltage}}{\text{Reduced Voltage}}\right)^2\right] \times 100$$

Equation 1: Reduction in percentage for reduced Voltage

If we apply this equation for the star delta starting, we see from equation 2 where the 67% reduction comes from:

$$\text{Reduction} = \left[1 - \left(\frac{V_{Line\ Delta}}{V_{Line\ Star}}\right)^2\right] \times 100 = \left[1 - \left(\frac{V_{Phase}}{\sqrt{3} \times V}\right)^2\right] \times 100 = \left[1 - \left(\frac{1}{\sqrt{3}}\right)^2\right] \times 100 = 66.6666\%$$

Equation 2: Reduction due to star delta starting

@ Sonargaon University


CHAPTER- 3

Design Methodology

3.1 Introduction:

The automatic star delta starter system is designed and developed by contactor and timer relay. The induction motor have wide variety characteristics, industrially it plays the premier role. Some of those are self-starting mechanism, heavy construction, high efficiency, good power factor etc. Different types of induction motor are available. Squirrel cage induction motors are mostly used than the other types. Small and medium size induction motors are started directly on line, but when very large motors are started that way, because of large amount of current flow through the motor. To reduce the high starting current, large induction motors are started at reduced voltage and then have full supply voltage reconnected when they reached to near to the rated speed.

3.2 Block diagram of star-delta starter:

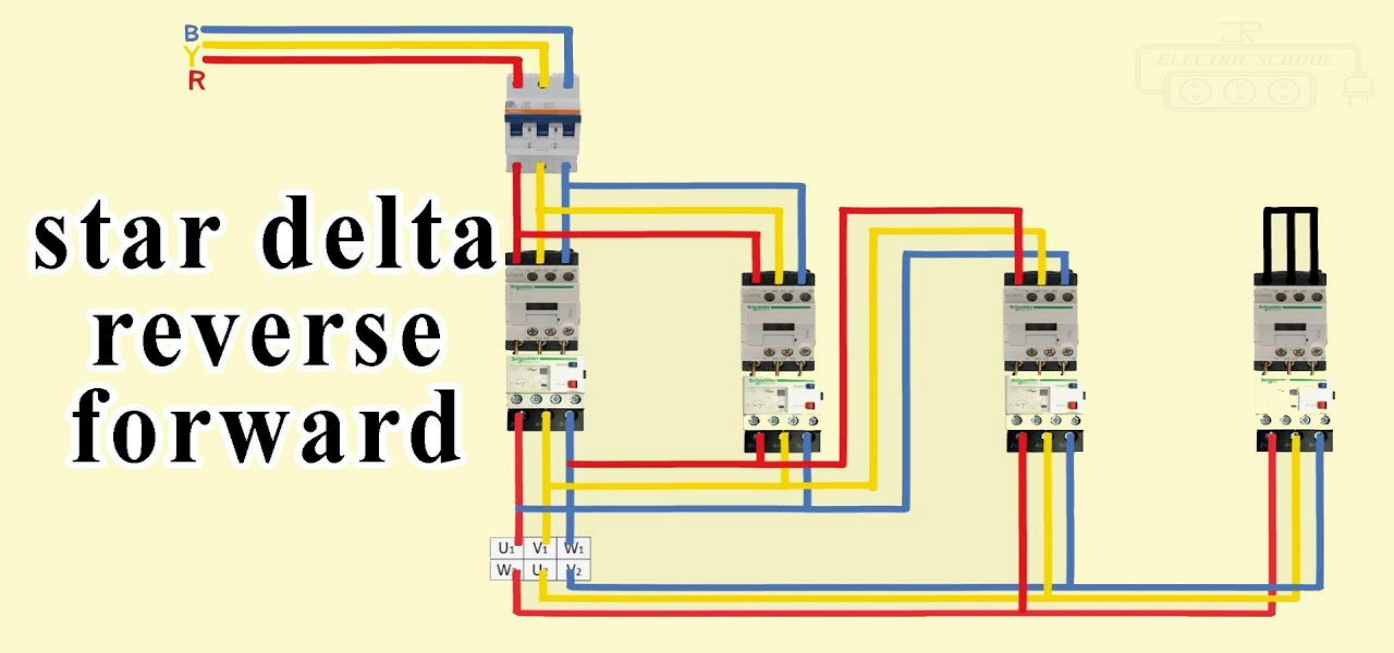

@ Sonargaon University

3.3 Flowchart:

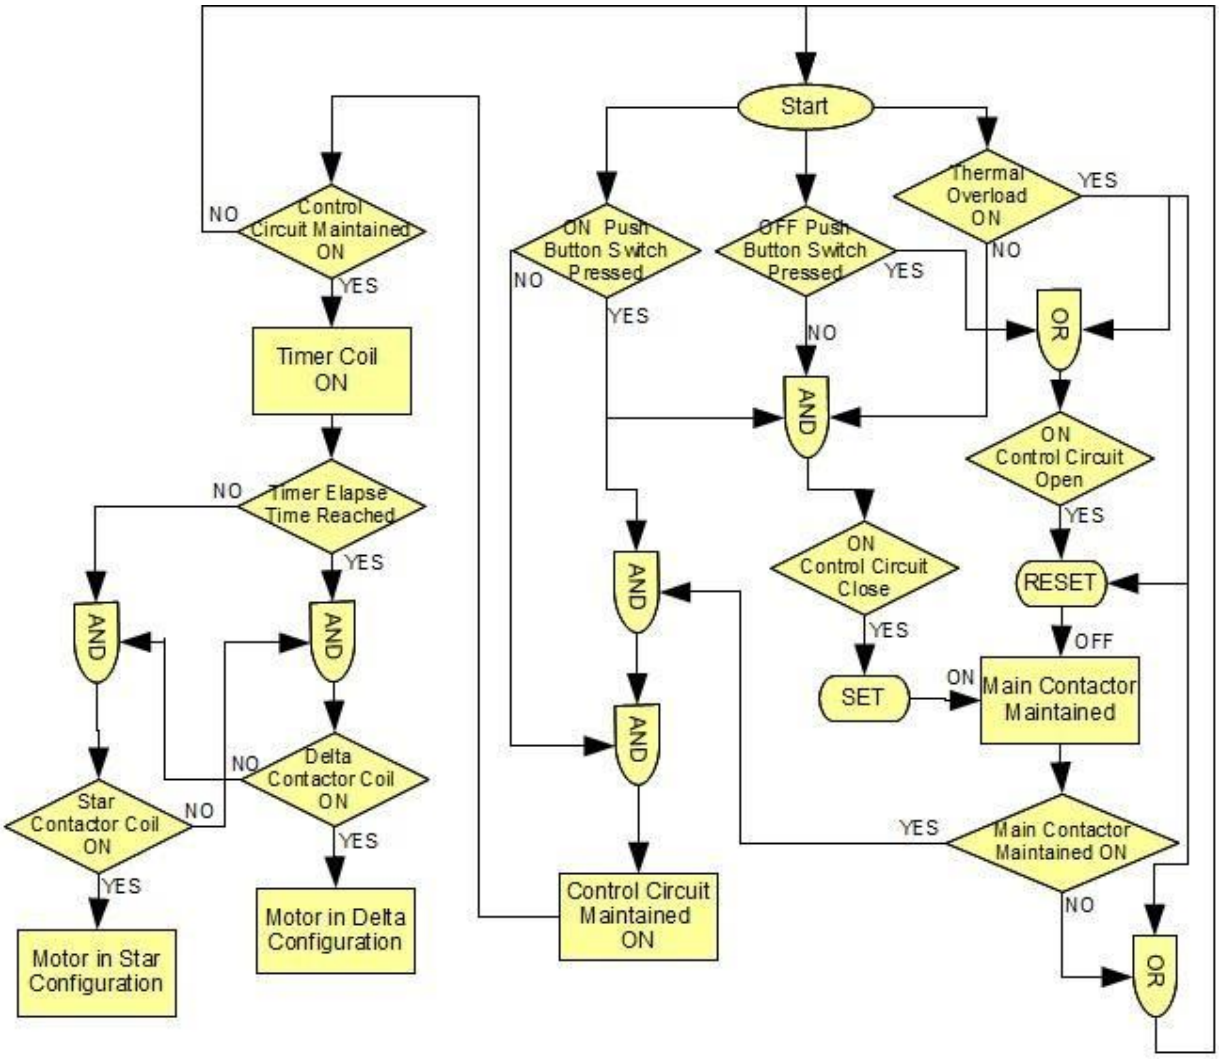


Figure-3.2: Flowchart

@ Sonargaon University

CHAPTER-4

Design and Implementation

4.1 Introduction:

This section illustrates the specific design of each block of the automatic star delta starter equipment along with the working of each part. Every block consists of several elements connected within the needed way to give the specified output .The comprehensive circuit illustration is provided add the end based on which the manufacture was completed .Special care was taken throughout the connection to avoid short circuit of paths during crossing of paths.

4.2 Our project consists of following hardware parts:

1. Magnetic conductor
2. Overload relay
3. Timer
4. Switch
5. Lamps
6. Board

4.2.1 Magnetic conductor:

There are three assembled contactors used for star delta starter. The ratings of contactors are about 18A 230 VAC which can work for a motor. The star and delta contactors are interlocked with a particular fixed time after which star to delta changeover in connection occurs. Below is the figure of Contactor.

@ Sonargaon University

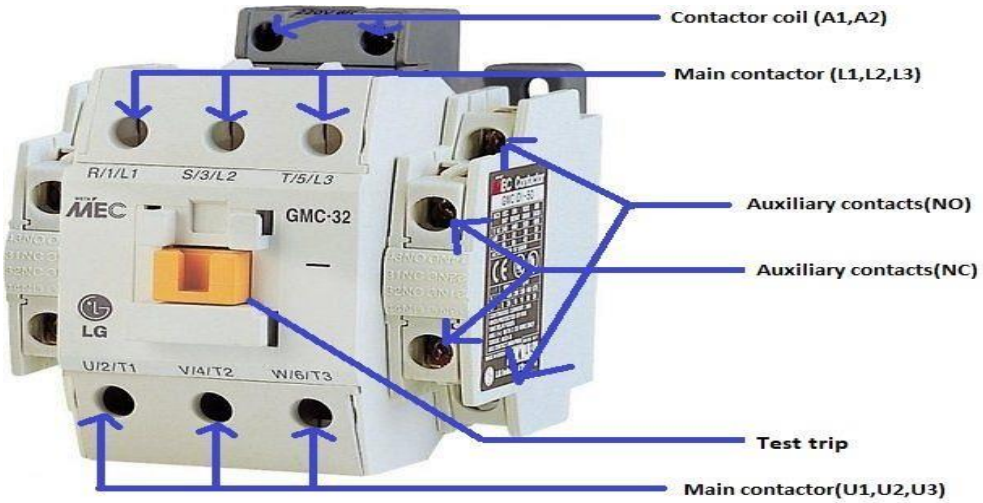


Figure 4.1: Magnetic conductor

4.2.2 Overload Relay:

Thermal overload relays are protecting devices which protect a motor against overload current and phase failure. It consists of set of indirectly heated bimetallic strips that deforms whenever the current exceeds limit. It also protect a motor against excessive heating, over-current, winding and winding insulation. It is design to stop power if the motor drawn to over current for an extended period of time. Thermal overload relays contain a normally closed (NC) relay. The ratings of overload relay are about 32A 3H which can work for a motor.

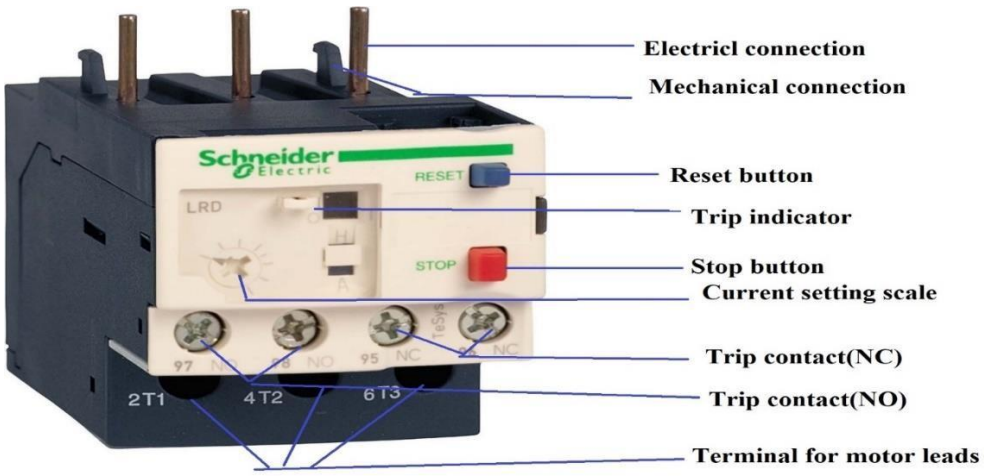


Figure 4.2: Overload relay

@ Sonargaon University

4.2.3 Timer Relay:

Timer is a control device which control the circuit. It is possible to construct a relay with a built in time delay device that causes the relay contacts to switch ON or switch OFF after a time delay. These type of relays are called time delay relays or Timer.

There are two basic types of time delay relay-

1.On delay timer or delay on timer.

2. Off delay timer or delay off timer.

Its rated current is 5A with 230V single phase AC supply 50Hz. The time within which star to delta changeover is done can be varied from 0 - 30 seconds. Below is the figure of Timer Box.

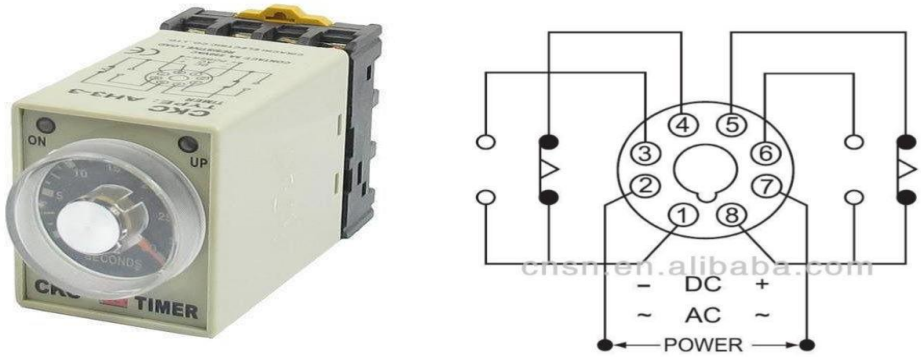


Figure 4.3: Timer & Its Connection

4.2.4 START and STOP push buttons switch:

These push buttons are based on the working principle of NO - normally open and NC - normally close type buttons. The START button here used is connected in NO type connection while for STOP button NC type connection is used. Below is the figure provided of START and STOP push buttons?

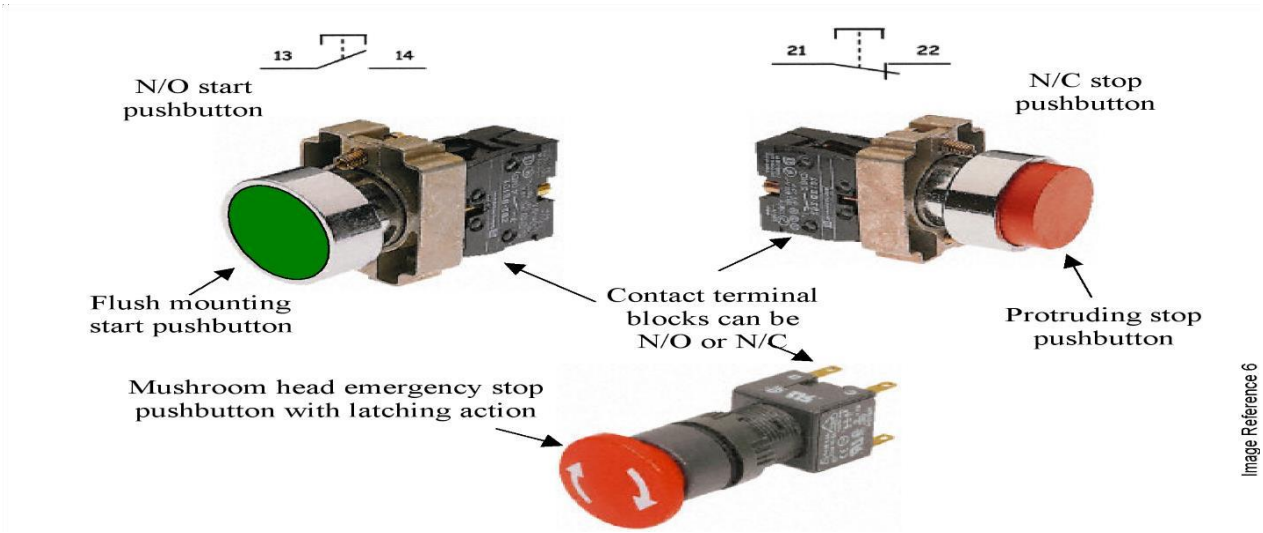


Figure 4.4: Start and stop button push switch


4.2.5 Cables:

The cables used here are of 2.5m. They can allow passing up to 15-16A of current. The resistance of 2.5 m according to resistance table provided by standard units is 8.21Ω/Km.

4.2.6 Interlock switches:

Interlock switches are safety switch which connected between star and delta contactor so that one can't activate without deactivating other contactor. For any fault if star and delta contactors are activated at the same time, the motor will be damaged.

4.3 Circuit diagram:

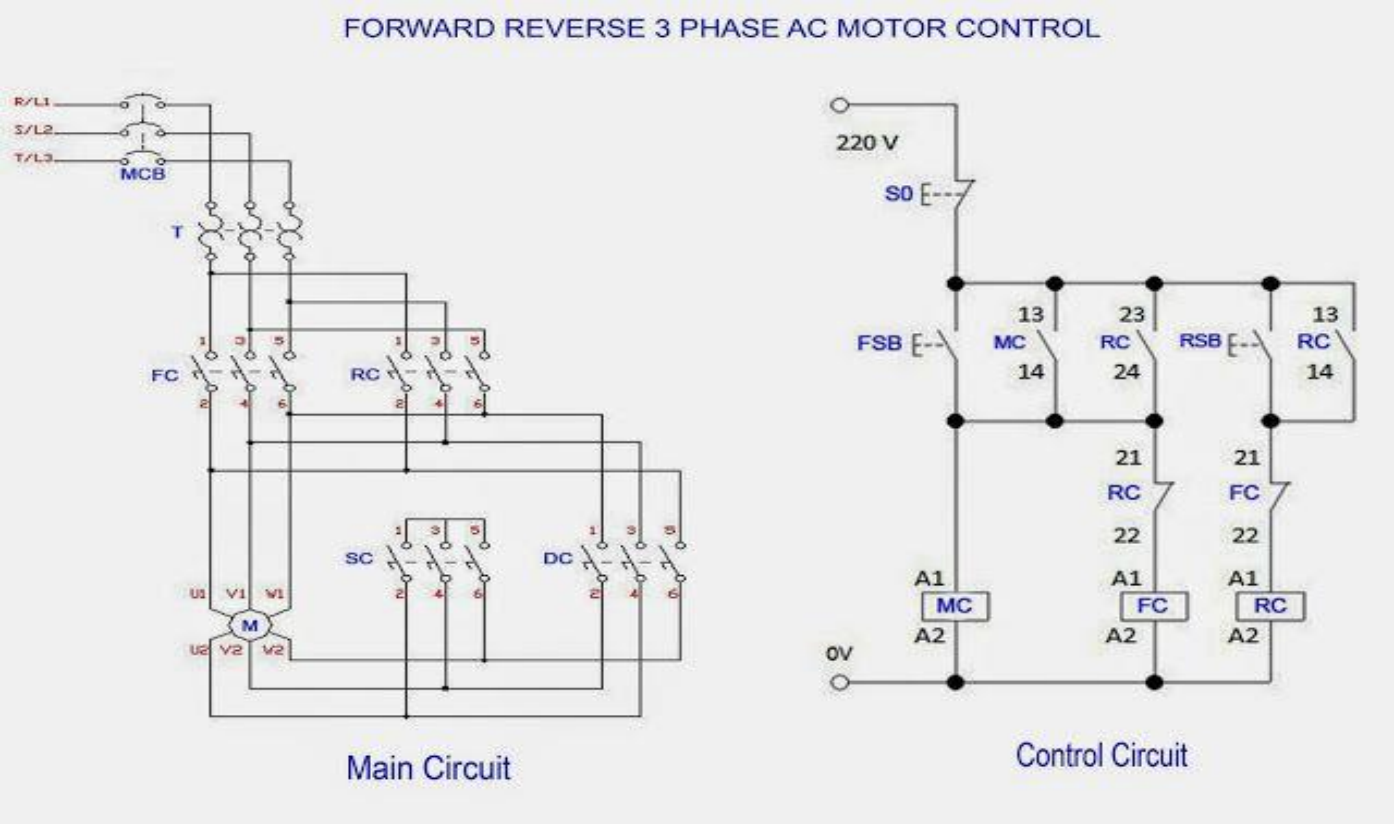

4.4 Operating principle:

The star-delta starter consists three contactor. There are main contractor, star contactor and delta contactor .The main and delta contactor are active during run mode. Then the winding of motor flow one-third of or 58% current in the line.


At the starting time, the star contactor is active until the time delay relay auxiliary contactor is open. The star contactor carries star current and the current is one third of rated current.

In run mode, the main and delta contactor are initially active and after a time, the star contactor is active until the timer contactor contact is deactivated. When the timer contactor is deactivate, the star contactor coil is open and at a time the delta contactor coil is active.The star delta changeover is done by timer relay. The two contactor star and delta are electrically interlock means one is active without other is deactivate.

@ Sonargaon University

Primary push the start switch and initially energized the main contactor and star contactor and timer relay contractor coil. When the star contractor coil energized and auxiliary contactor change its state normally open to close. In consequence of main contractor coil active in moment of time and its auxiliary contactor change its state normally open to close. Start switch is momentary push buttons switch. Momentary switch is switch which remains active as long as it is being compressed. The main contactor auxiliary switch NO is latched to the start switch. When the star contactor coil is active, motor run in star mode. It is active until timer auxiliary contractor change its state NC to open. While the timer is running on 5sec or reached the specified time, its auxiliary contactor change the position NC to open. At the same time the delta main contactor is active and the motor run in delta mode. Star auxiliary close contactor is connect to delta main coil and delta auxiliary close contactor is connect to star main coil. This system is called interlock. This two switches are together called interlock switch. Interlock switch one cannot active without other deactivate. When star contactor coil active, the delta contractor coil cannot be active without deactivate the star contactor coil. Similarly when delta contactor coil active, the star contactor coil cannot be active without deactivate the delta contactor coil. Stop switch is used for disconnect the circuit, when the motor needed. The overload relay is safety device which protect the motor against high current, excessive heat, phase failure, wind and wind insulation fail etc.

@ Sonargaon University

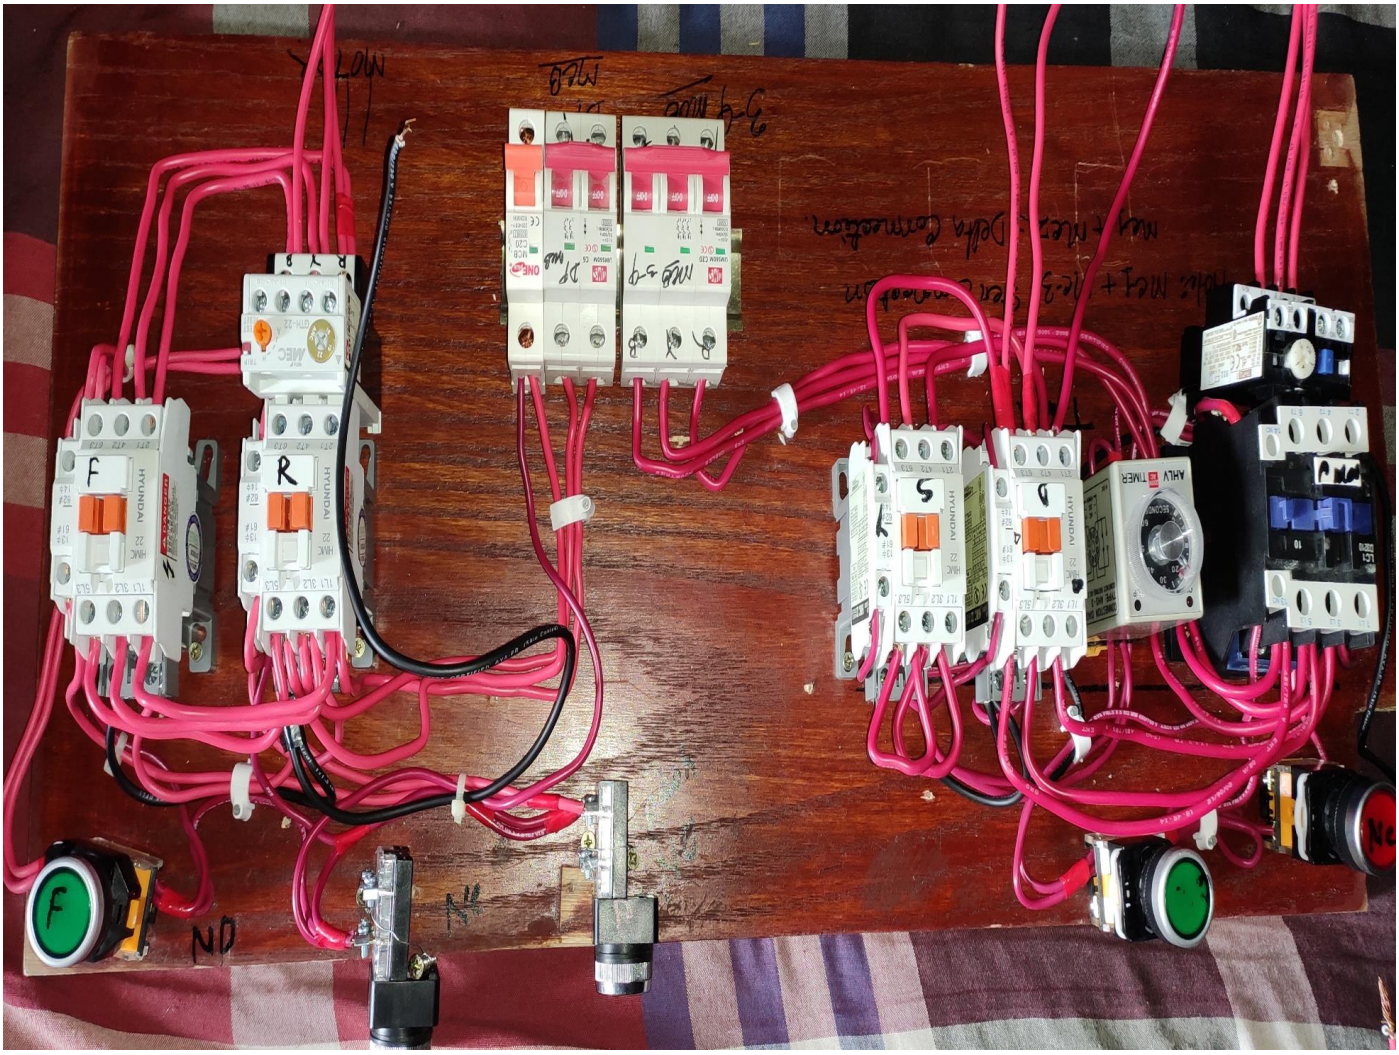

Project image.

@ Sonargaon University

CHAPTER-5
RESULTS AND COST ANAYLYSIS

5.1Introduction:

The value of any gadget planned must be confirmed after it is utilized and expected outcome is accomplished. In this chapter a brief description about the result and financial viability has been discussed. A cost efficient study is essential to demonstrate that the projected system will be supportive for industry to have a proficient operation and reduced energy consumption.

5.1 Result:

The presented system is planned and configured for practical use. This system is able to reduce high starting current. In this method at first motor terminal connect star system and we know start connection system line current is equal to the phase current and for this reason starting time motor achieve low starting current. After 5 second motor running delta mode operation. Delta connected system line current is root three times of phase current. So motor get full voltage and then the motor reaches its rated speed. The motor at starting is reduced to 1/3 as compared to starting current with the windings connected in delta. Finally motor run without damage. This method is used worldwide.

5.2 Three phase motor current rating for star delta control:

Total power of the three phase motor equation is,

P=$\sqrt{3}v_l l_l \cos\emptyset$ Where, v_{ph}=240V, v_l=415V

@ Sonargaon University

3ph Motor rating at 400v 50HZ		STAR	DELTA
K.W	H.P	AMP	AMP
5.5	7.5	9	15.6
7.5	10	12	21
9.3	12.5	14	26
10	13.5	16.3	28
11	15	18	31
15	20	24.5	42

Figure-5.1: Three phase motor current rating for star delta

5.3 Cost sheet:

Name	**Model**	**Quantity**	**Purchase price**
Magnetic Conductor	LG	3	1800
Overload Relay	LS	1	400
Timer	TEE	1	350
Lamp	AD16	3	75
Switch	LA38	2	90
Board	Plastic	1	80
Wire	BD	1	150

Figure-5.2: Cost sheet

5.4 Cost comparison:

Forward reverse Star delta control is very common types of starter and extensively used, compared to other types of starter. Motor is one of the expensive equipment in the industry. Induction Motor is very sensitive. In this project we design star delta starter which protect the motor of starting moment. It is the cheapest and safe way to start the induction motor available to other.

CHAPTER-6

Advantage

There are certainly many advantages of our project and some of the major ones have been given below:

- The operation of the star-delta method is simple and rugged
- Starting Current and torque is reduced to 33%
- Works good in light-loaded conditions also
- No Heat will be produced
- Less Mechanical Stress.
- Automatic changeover makes reduces manual work.
- Mechanical stress is less
- Star-Delta starters are widely used due to their relatively low price.
- There are no limits to the number of times they can be operated.
  The components require very little space.
- The starting current is reduced to approximately one-third.

@ Sonargaon University

Disadvantage:

- The starter can only be applied to motors where the six leads or terminals can be accessed.

- The supply voltage must be the same as the rated motor voltage for Delta connection.
- Because the starting current is reduced to approximately one-third of the rated current, the starting torque is also reduced to one-third.

- If the motor does not reach at least 90% of its rated speed at the time of switching from Star to Delta the current peak will be as high as in a D.O.L. start, thus causing harmful effects to the contacts of the contactors and the connection system brings no advantage to the electrical system

@ Sonargaon University

CHAPTER-7

CONCLUSIONS

This starting method is used for medium voltage and light starting torque motors. This is one of the best way to reduce the high starting current. If the large induction motor start in direct online method, the motor can draw 5-6 times of rated current. The large amount of current can be easily reduce by the magnetic contactor, relays and the timer circuit.

The methode is designed to provide low voltage start to motors. This is achieved by using star to delta conversion. Different types of starter are available. Star/Delta starters are most common and best way to reduced voltage in the 50Hz industrial motor world.

Using the method easily reduce the high starting current to the motor then after sometime full load current is applied to the motor. Since in star connected system line current is equal to the phase current while line voltage is the $\sqrt{3}$ times the phase voltage. If motor is started as star ,the voltage is must be reduced.

The interlocking arrangement of all the contactor coils is traditionally wired in 440-volt AC. The project is designed to provide low voltage start to induction motors. The Star-Delta starter manufactured from three magnetic contactors, overload relays and timer for operatinga 3-phase motor at 440 v and 50 Hz.

@ Sonargaon University

6.1 Limitation of the work:

1. Six Terminal Motor Required.
2. The starting torque is low, it's only 33%.
3. The application with a load torque higher than 50% of the full torque will not be able to start using the method
4. Break in supply

6.2 Future Scopes:

This is the best method to reduced high starting current and it is the very easy and cheaper than other device. But it receive large in rush currents during switching operation. Further the project can be enhanced by using a thyristor in firing angle control principle for soft start of the induction motor that would overcome all the drawbacks of forward reverse star delta control.

REFERENCES

1. static.elitesecurity.org/uploads/2/5/2500371/Star%20delta.pdf

2. https://electrical-engineering-portal.com › Technical Articles

3. www.ijirt.org/master/publishedpaper/IJIRT100996_PAPER.pd

4. http://www.ghrcema.raisoni.net/TRPCS-2K17.php

5. http://dx.doi.org/10.21474/IJAR01/6965

6. www.electrical4u.com

7. https://www.rm-electrical.com/wp-content/uploads/2014/11/MOTOR-CURRENT-RM-Technical.pdf

Appendix

Motor Current Charts

SINGLE PHASE MOTORS

MOTOR RATING	HP	APPROX. F.L.C. AT LINE VOLTAGE		
		110V ac	220V ac	240V ac
0.07 kW	1/12	2.4	1.2	1.1
0.1 kW	1/8	3.3	1.6	1.5
0.12 kW	1/6	3.8	1.9	1.7
0.18 kW	1/4	4.5	2.3	2.1
0.25 kW	1/3	5.8	2.9	2.6
0.37 kW	1/2	7.9	3.9	3.6
0.56 kW	3/4	11	5.5	5
0.75 kW	1	15	7.3	6.7
1.1 kW	1.5	21	10	9
1.5 kW	2	26	13	12
2.2 kW	3	37	19	17
3 kW	4	49	24	22
3.7 kW	5	54	27	25
4 kW	5.5	60	30	27
5.5 kW	7.5	85	41	38
7.5 kW	10	110	55	50

@ Sonargaon University

THREE PHASE MOTORS

MOTOR RATING	HP	APPROX. F.L.C. AT LINE VOLTAGE				
		220V ac	240V ac	380V ac	415V ac	550V ac
0.1 kW	1/8	0.7	0.6	0.4	0.4	0.3
0.12 kW	1/6	1	0.9	0.5	0.5	0.3
0.18 kW	1/4	1.3	1.2	0.8	0.7	0.4
0.25 kW	1/3	1.6	1.5	0.9	0.9	0.6
0.37 kW	1/2	2.5	2.3	1.4	1.3	0.8
0.56 kW	3/4	3.1	2.8	1.8	1.6	1.1
0.75 kW	1	3.5	3.2	2	1.8	1.4
1.1 kW	1.5	5	4.5	2.8	2.6	1.9
1.5 kW	2	6.4	5.8	3.7	3.4	2.6
2.2 kW	3	9.5	8.7	5.5	5	3.5
3.0 kW	4	12	11	7	6.5	4.7
3.7 kW	5	15	13	8	8	6
4.0 kW	5.5	16	14	9	8	6
5.5 kW	7.5	20	19	12	11	8
7.5 kW	10	27	25	16	15	11
9.3 kW	12.5	34	32	20	18	14
10 kW	13.5	37	34	22	20	15
11 kW	15	41	37	23	22	16
15 kW	20	64	50	31	28	21
18 kW	25	67	62	39	36	26
22 kW	30	74	70	43	39	30
30 kW	40	99	91	57	52	41
37 kW	50	130	119	75	69	50
45 kW	60	147	136	86	79	59
55 kW	75	183	166	105	96	72
75 kW	100	239	219	138	125	95
90 kW	125	301	269	170	156	117
110 kW	150	350	325	205	189	142
130 kW	175	410	389	245	224	169
150 kW	200	505	440	278	255	192

@ Sonargaon University